




**SOUND ABSORPTION COEFFICIENT TESTED IN A REVERBERATION ROOM  
IN ACCORDANCE WITH ISO 354  
RATED IN ACCORDANCE WITH EN ISO 11654**

General Data	
Test Report No	C/23242/T01a
Product	LinCrete GFRC cladding with perforated elements
Acoustic backing	Mineral wool, thickness: 75mm
Perforation type	57/66/36
Hole characteristics	conical; $\varnothing$ 36 – 32.5 mm
Open area	14 %

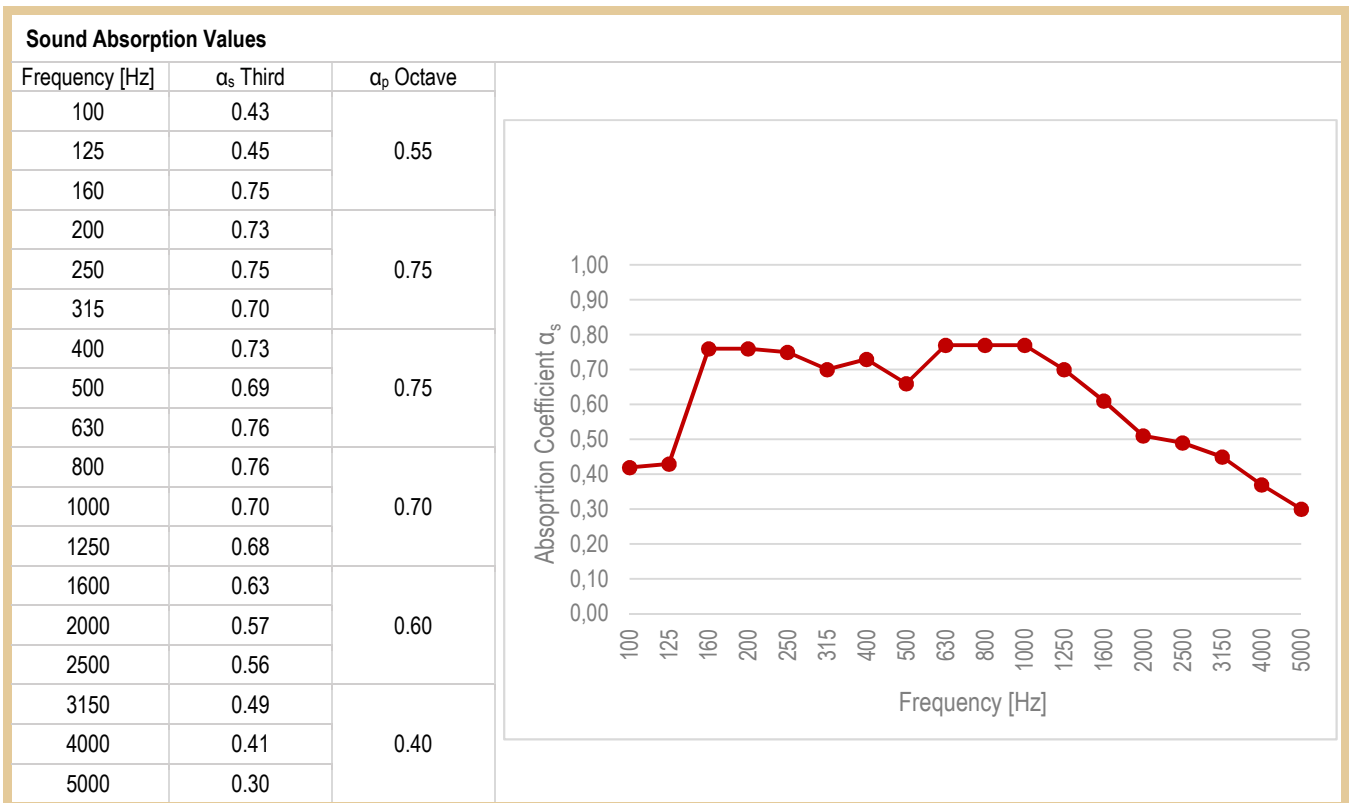

Rated Performance Data			
Rated in accordance with ISO 11654		Rated in accordance with ASTM C 423	
Rated sound absorption coefficient	$\alpha_w = 0.60$ (L)	Noise Reduction Coefficient	NRC = 0.70
Sound absorption class	C		